


HT-25/34 Timer Modification (to avoid feeder activation during initial filling) 4/08



Exhaust fan relay

Wash contactor on HT
Conveyor contactor of 44/66

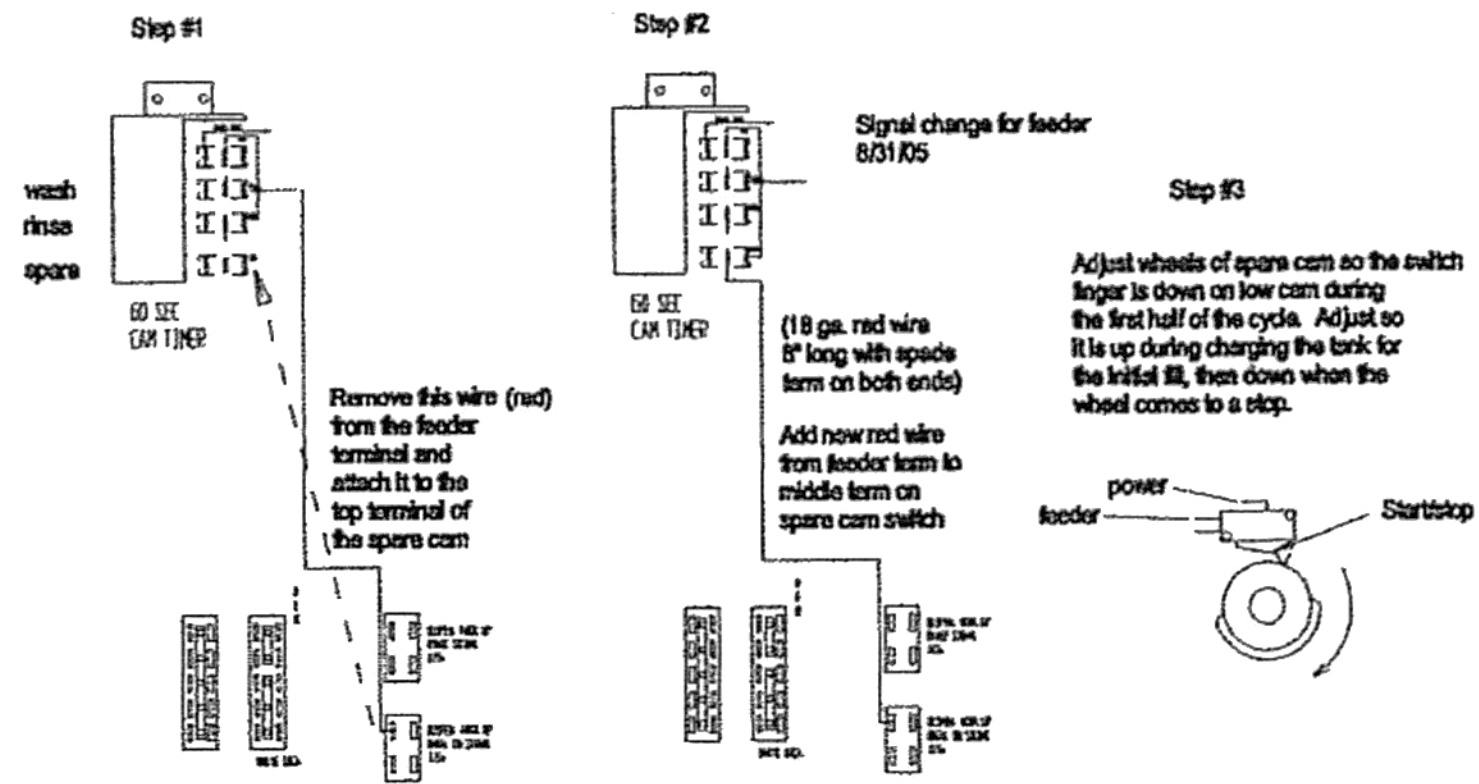